



NSF International Beverage Quality
Statement of Audit Completion

EUREAU SOURCES SAS


Audit Location

EUREAU SOURCES SAS - Site Saint Hippolyte 37
La Bondaire 37600 Saint Hippolyte
France

Company is a participant in the audit program
Association Française de l'Industrie des Fontaines à Eau
Bottler

Date of Audit

11-JAN-2022

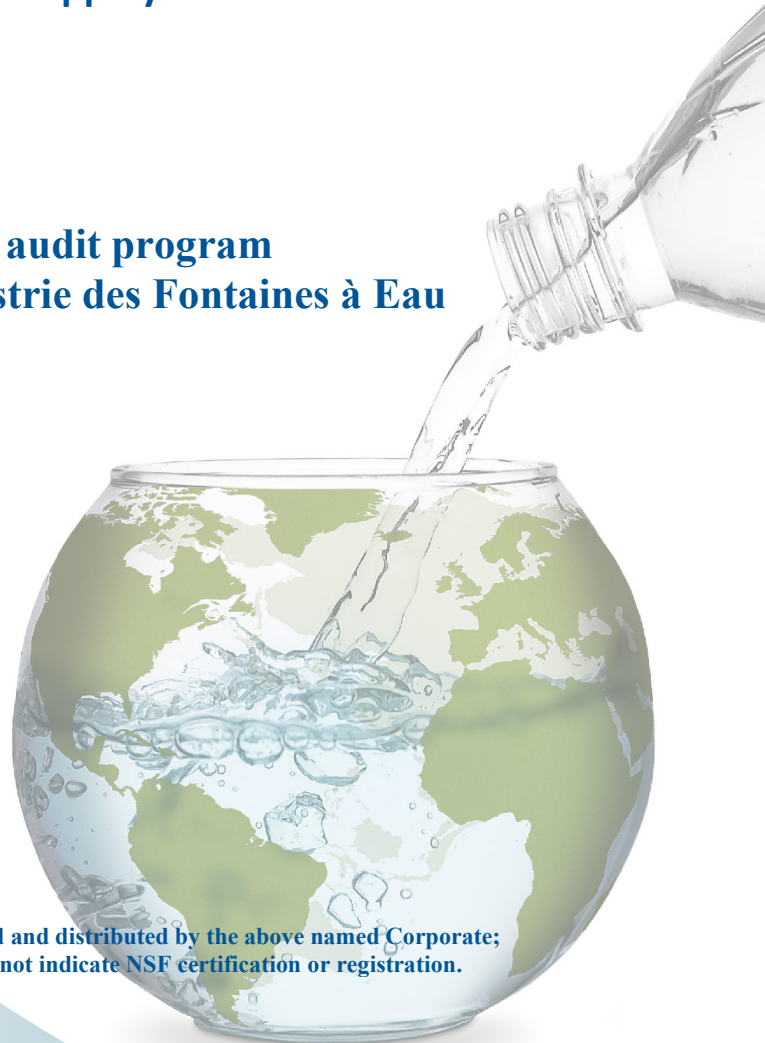

This page (1 of 1) is a public document; may be displayed and distributed by the above named Corporate; expires one (1) year from the above audit date; and does not indicate NSF certification or registration.

Audit report and scoring grid for watercoolers bottling plants

Rapport d'Audit et grille de score applicable à l'embouteillage de bonbonnes d'eau pour fontaines réfrigérantes



version from 2017/09/21

Audit of the company:

Audit de la société :

Eureau Sources SAS

Source of:

Source de :

Serenea from St. Hippolyte

Date of completion of the audit:

Date de réalisation de l'audit :

11/01/2022

Name of the Auditor:
Society of the Auditor:
Contact details of the auditor (Tel, fax, mail):

Nom de l'Auditeur :
Société de l'Auditeur :
Coordonnées de l'auditeur (Tel, fax, mail) :

Hans-Christian Eder
NSF International
+491703279784
heder@nsf.org
Jean Cadart
+33687974274
icadart@eureausources.com
3 annual recurring audit

Accompanying person (s) of the company audited:
Contact details (Tel, fax, mail):

Personne(s) accompagnatrice(s) de la société auditée :
Coordonnées de l'accompagnateur (Tel, fax, mail) :

Objective of the Audit:
Annual visit:
Initial visit:
Special visit:
Date of first audit carried out according to AFIFAE requirements:

Objectif de l'Audit :
Visite annuelle :
Visite initiale :
Visite spéciale :
Date du premier audit réalisé d'après le référentiel AFIFAE :

28/03/2017

Score obtained for watercoolers:

Maximum score applicable:
% Of the obtained score:
Number of failures on 18 critical points (CP):
Audit validated (yes / no): See page 5 of the audit guide
Action plan to be provided to the auditor for:

Score obtenu pour les fontaines à bonbonnes :

Score maximum applicable :
% du score obtenu :
Nombre d'échec sur les **18** points critiques (**CP**) :
Audit validé (oui / non) : Cf. p 5 du guide d'audit
Plan d'action à fournir à l'auditeur pour le :
Audit à compléter par une visite complémentaire (oui / non) :

	999
	1045
	95,60
	0
yes	

Signature of auditor:

Signature de l'auditeur :

Signature de l'accompagnateur :

Remarques et commentaires généraux / General remarks and comments
This watercooler bottling plant was approximately 150 Km south of Orleans. It opened in 2003 and can bottle at up to 1,000 large bottles an hour. The spring water borehole is 214m deep and the aquifer has a big protective layer of "Tufleau de Touraine". The age of the water is considered to be probably 20-30 years old. There was iron and ammonium removal from the source water by use of compressed air, bacteria and sand filtration, further treatment was mechanical filtration with 5µm and 1µm cartridge filters. There is no municipal water used for bottle washing - instead water from a second borehole is treated with chlorination for this purpose. The laboratory on site closely monitors the microbiological and chemical parameters of the water and the washed bottles.